



A-98 450-116
UNASSIGNED UNITS
577.062
M-1 #1 8/17/79

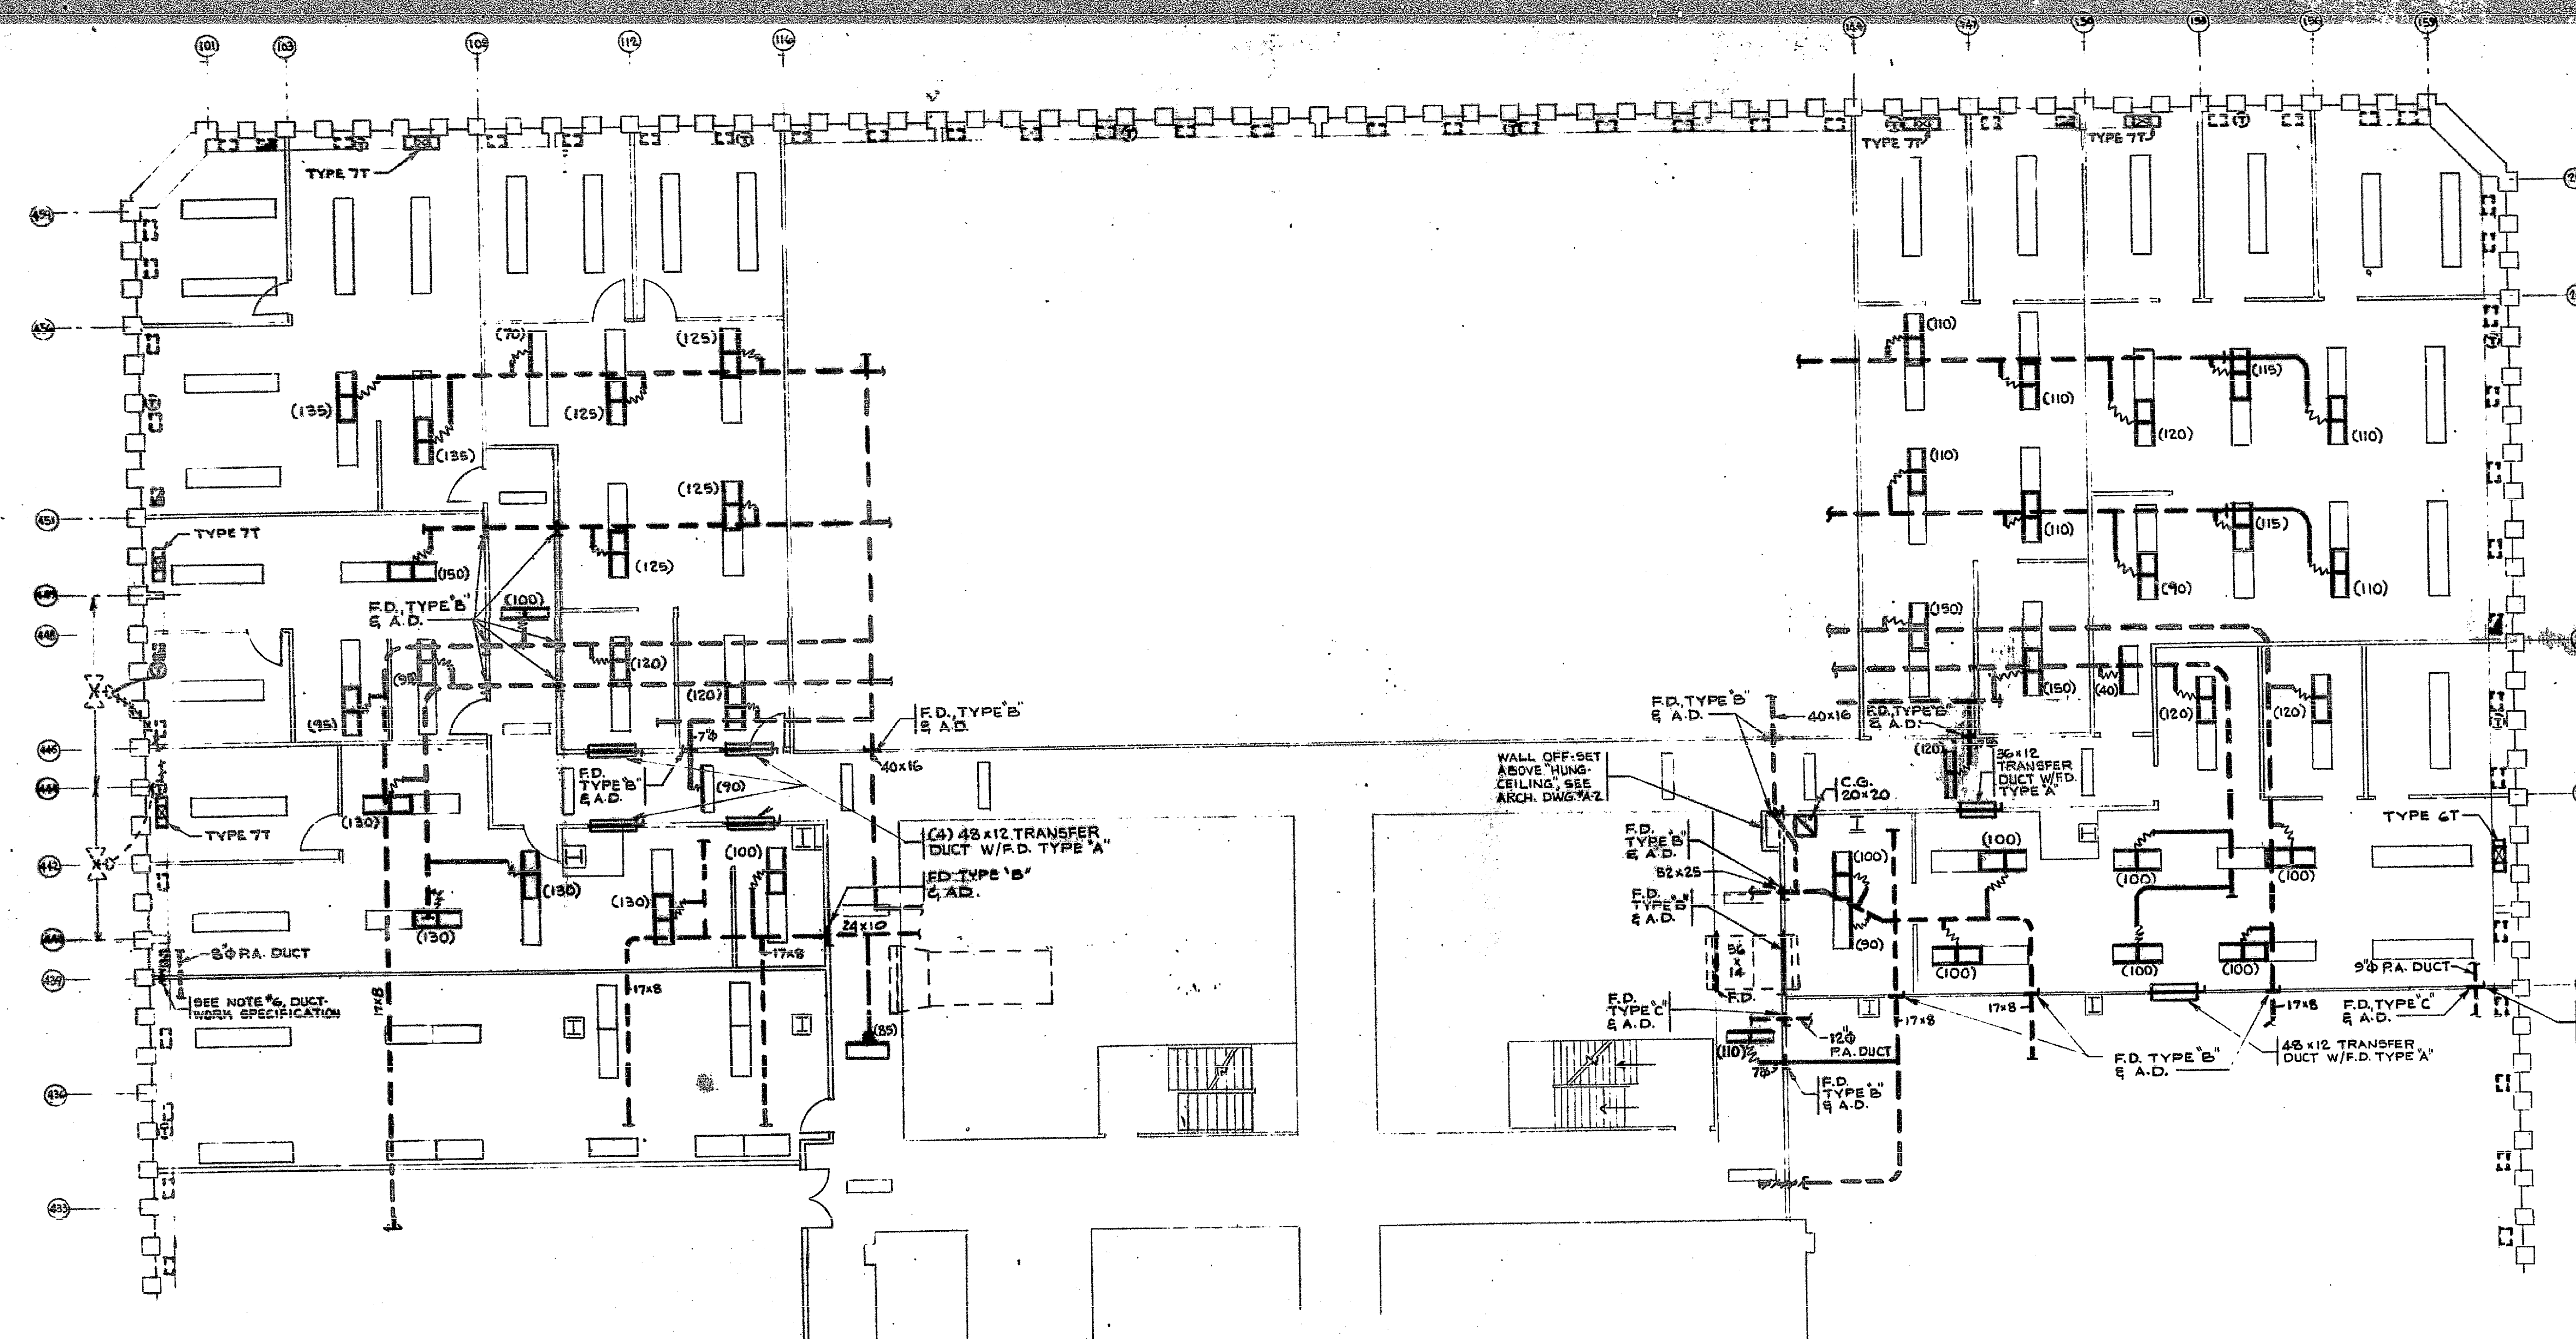

GENERAL NOTES

1. ALL FINGER DUCTS & FLEXIBLE CONNECTIONS ARE 7"Ø REGARDLESS OF CFM.
2. SEE DWG. #M-3 FOR FIRE DAMPER & TRANSFER DUCT INSTALLATION DETAILS.
3. SEE DWG. #M-2 FOR INDUCTION UNIT INSTALLATION DETAIL, SCHEDULE, LEGEND & SPECIFICATIONS.

RELEASED FOR BIDDING
BY *[Signature]* DATE 9-12-79
RELEASED FOR CONSTRUCTION
BY *[Signature]* DATE 10/18/79
MANAGER, WTC PLANNING DIVISION

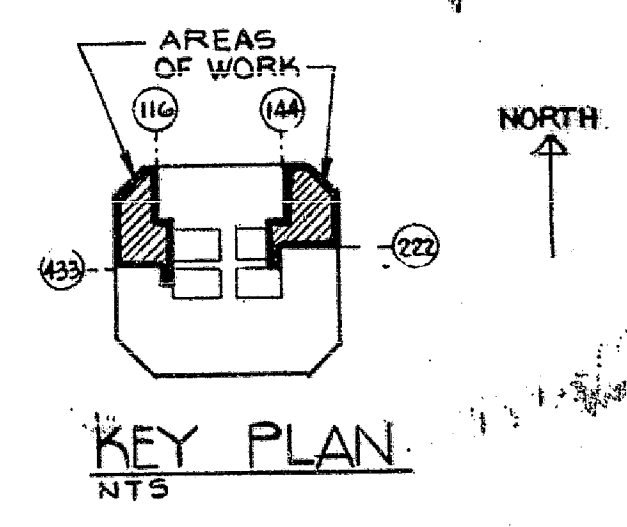

THIS DRAWING SUBJECT TO CONDITIONS IN CONTRACT. ALL INVENTIONS, IDEAS, DESIGNS AND METHODS HEREIN ARE RESERVED TO PORT AUTHORITY AND MAY NOT BE USED WITHOUT ITS WRITTEN CONSENT.

DESIGNED R.D.S. DRAWN	REVISIONS				NO.	DATE	APPD.	DESCRIPTION
	NO.	DATE	APPD.	DESCRIPTION				
	1	5-7-79		GENERAL REVISIONS				
CHECKED								
IN CHARGE								

[Signature]
CHIEF ENGINEER
[Signature]
CHIEF MECHANICAL ENGINEER

[Signature]
ENGINEER OF DESIGN
AIR PORTS & WTC
JULY 6, 1979
DATE

THE PORT AUTHORITY OF NY & NJ
THE WORLD TRADE CENTER
TOWER A 98TH FLOOR
UNASSIGNED UNITS

MECHANICAL
PLAN

CONTRACT NO. WTC 577.062 DRAWING NO. M-1